

# Beam-column joint tests with grade 500E reinforcing

L.M. Megget & N.J. Brooke

*Department of Civil & Environmental Engineering, University of Auckland, New Zealand.*

R.C. Fenwick

*Visitor, Department of Civil Engineering, University of Canterbury, New Zealand.*



**2004 NZSEE  
Conference**

**ABSTRACT:** A database of beam-column joint test results has been assembled and analysed to determine appropriate design drift limits for the prevention of bond failure in reinforced concrete frames. In order to enhance the coverage of the database for units in which higher grade reinforcement with bar diameters in excess of 16mm were used, further beam-column joints have been designed at the University of Auckland using 25 mm beam reinforcement. The result of the first of these tests is reported. Despite not meeting the requirements of the recent amendment to NZS 3101:1995 with respect to column depth, the unit did not exhibit a bond failure in the joint region.

## 1 INTRODUCTION

Since the introduction of grade 500 reinforcing steel to the New Zealand market, concerns have been raised concerning the validity of existing design guidelines with the new higher grade reinforcement. In particular, attention has been given to the increased likelihood of bond failure within interior beam-column joints.

In order to assess the influence of using grade 500 reinforcing steel in beams, a database of test results for beam-column joint sub-assemblies was compiled. This database consisted of 59 tests. It included a database of 48 tests compiled Lin (1999) with additional tests reported by Blakeley et al. (1975) and (1979), Young (1998), and Megget et al.(2003). This data has been analysed and suggestions are made on how to control bond failure in joints zones.

Within the database there are few units incorporating reinforcement with a yield stress of 500 MPa or more, and only one of these had beam reinforcement with bar diameters greater than 20 mm. To rectify this deficiency a further series of tests on four beam-column joints has been initiated at the University of Auckland. These tests use 25 mm grade 500E (HD25) reinforcing steel in the beams. The results of the first of these tests are discussed in this paper.

## 2 BOND FAILURE IN BEAM COLUMN JOINTS

There are three failure modes for beam-column joints (Fenwick and Megget 2003). These are:


- Failure of the plastic hinge zones through shear and flexure
- Shear failure of the joint zone
- Bond failure of the longitudinal beam reinforcement in the joint zone

The least serious of these is bond failure. This failure mode results in a loss of strength and stiffness of the beams and hence it reduces the strength of the beam failure away mode. In contrast the other two failure modes can reduce the strength of the columns and lead to the less ductile column sway (weak storey) failure mode (Fenwick and Megget 2003). Additionally, it is considered that some bond deterioration is inevitable in beam-column joints experiencing reversing inelastic demands (Hakuto et al. 1999). For these reasons, it is logical that a lower level of safety against bond failure may be provided than against the other potential failure mechanisms.

In analyzing the database of test results, it was necessary to identify those tests in which bond failure of the joint zone was the primary cause of failure. Examination of the test results showed that for joints containing at least 75% of the joint zone shear reinforcement required by NZS 3101:1995 a joint zone shear failure was unlikely to precede bond failure of the beam reinforcement (Fenwick and Megget 2003). This criterion reduced the number of tests, which could be used to assess bond performance to 29 tests.

## 2.1 Drift Level at Bond Failure

Bond failure was assumed to have occurred if the load sustained at a target drift was less than 25% of the maximum value when the drift was half way between the target drift and a position of zero load (see Figure 1). The failure was assumed to have taken place at the peak drift of the previous cycle. To recognize the superior performance of cases where a unit sustained a drift level several times before bond failure occurred, 0.25% was added to the failure drift (drift limit) for each successful half cycle to the same peak displacement before bond failure.

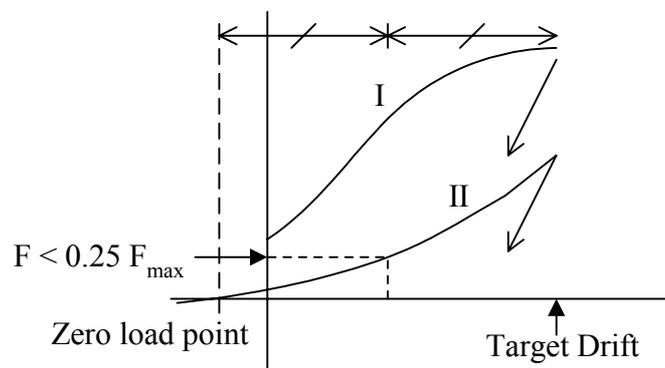

**Figure 1** Criteria used to determine occurrence of bond failure.

It was thought likely that bond failure occurred at an earlier stage than that where strength loss was noted. This assumption was accounted for by defining a “modified drift limit” as equal to the drift limit from above divided by one plus the proportion of strength lost. Use of the modified drift limit reduced the scatter of plots relating drift limits to other variables.

## 2.2 Analysis of Test Results

It is evident from **Figure 2** that there is a strong correlation between the modified drift limit and the yield stress. It is noted that for the tests using higher grade reinforcement the ratio of bar size used in the test to the maximum bar size allowed by NZS 3101:1995 (numbers by data points) increased with reinforcement grade. This can be attributed to the relaxation of the bond criterion in the standard around the time grade 430 reinforcing steel was introduced.

By plotting modified drift at bond failure multiplied by the square root of the ratio of actual bar size to allowable bar size against yield stress (see **Figure 3**) design values of allowable drift can be assessed. If the maximum permitted bar diameter to be used (i.e.  $d_{ba}/d_{bc} = 1.0$ ) the average value of modified drift at bond failure can be determined. For grade 500 reinforcing ( $f_{y \text{ average}} \sim 550$  MPa) the value is 3.1%, with a standard deviation of 0.47%. Similarly, for grade 300 steel ( $f_{y \text{ average}} = 320$  MPa) the value is 4.7%, standard deviation 0.55%. The data from the unit described in this paper is shown on both **Figure 2** & **Figure 3**, but was not included in the analyses based on these figures.

For a 90% probability that bond failure will not occur in the ultimate limit state, the drift limits for the two grades of reinforcing are reduced to (Fenwick and Megget 2003):

- 3.5% drift for Grade 300 reinforcement
- 2.5% drift for Grade 500 reinforcement.

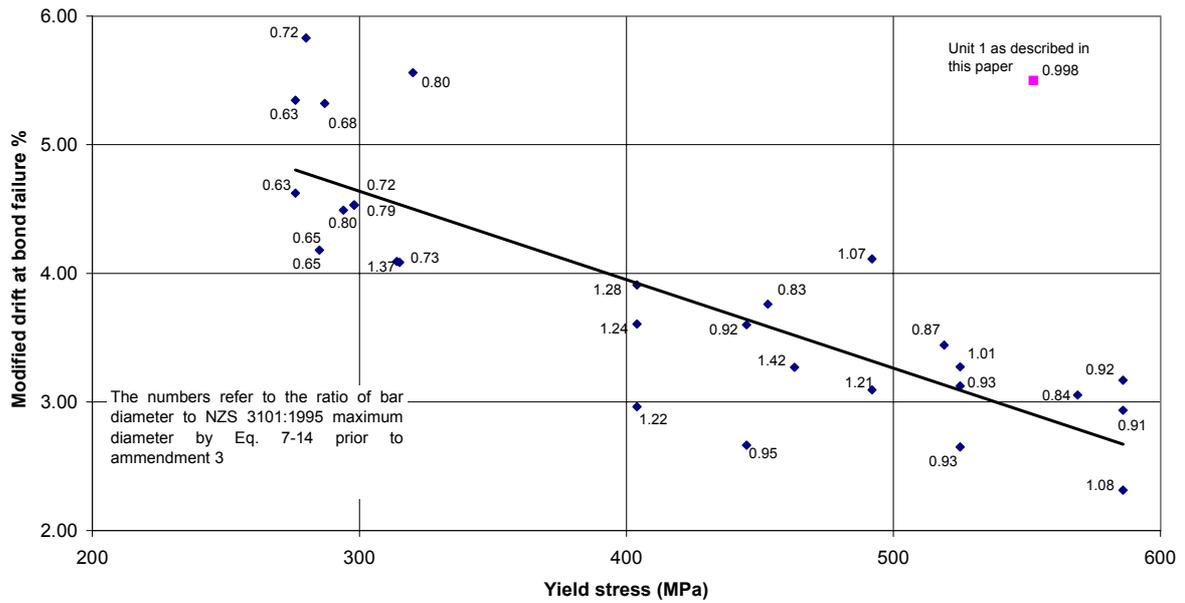


Figure 2 Modified drift at bond failure versus yield stress of reinforcement.

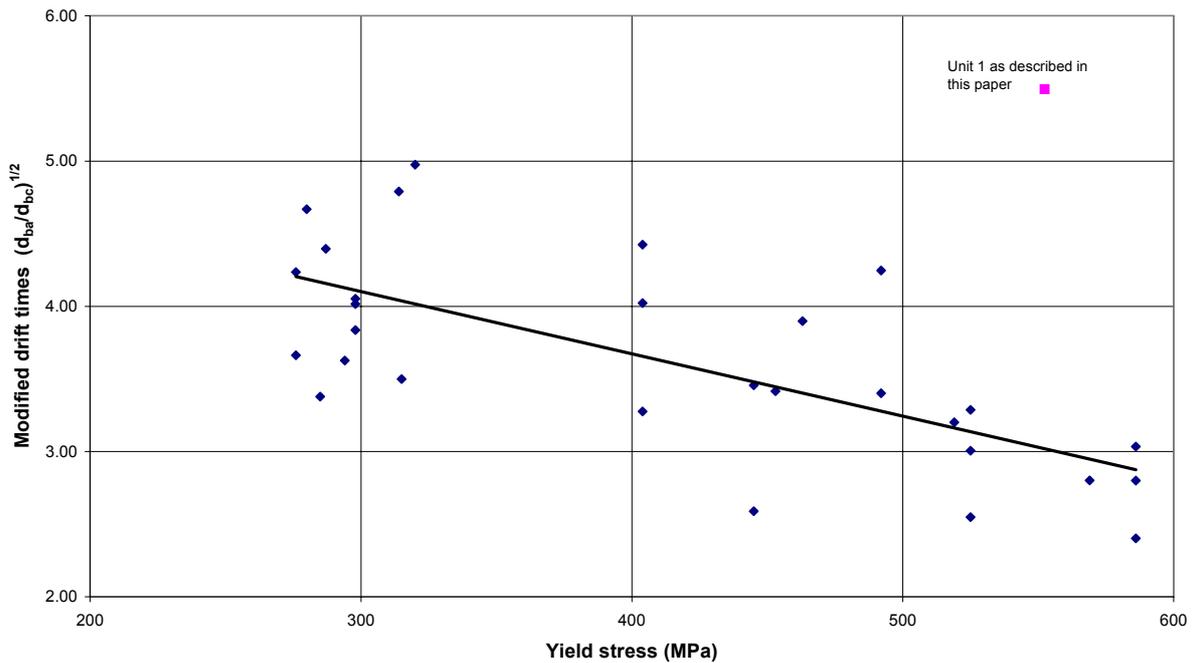


Figure 3 Modified drift at bond failure \*  $(d_{ba}/d_{bc})^{1/2}$  versus yield stress.

It has been shown (Paulay 1978) that elastic methods of analysis can significantly underestimate drift values compared to those calculated by inelastic time history analysis. This is recognized by the New Zealand loading standard (NZS 4203 1992) through the inclusion of a factor to allow for the underestimation. This factor varies with building height from 1.25 for a building of height less than 15m to 1.67 for buildings taller than 30 m (NZS 4203 1992). It is also necessary to account for the  $S_p$  factor incorporated in NZS 4203. To do this, the ultimate limit state drift should be divided by  $1/S_p$ , i.e. 1.5. It is reasonable to reduce this value somewhat to allow for the fact that the earthquake does not cycle between drift extremes as occurs in laboratory testing. Therefore, a value of 1.25 has been

used to produce design drift limits to prevent bond failure (see Table 1)


**Table 1. Design drift limits to prevent bond failure**

Building height	Grade 300E	Grade 500E
(m)	(MPa)	(MPa)
<15	2.24%	1.60%
>30	1.68%	1.20%

### 3 ADDITIONAL INTERNAL BEAM-COLUMN JOINT TESTS

#### 3.1 Design of Units

In order to fill the gaps in the database of beam-column test results, four further tests are being undertaken at the University of Auckland. Three of these units have been designed, and the first has been built and tested. The beam longitudinal reinforcement for the first three units is to be kept constant as 3 HD25 bars top and bottom, while the target compressive strength of the concrete selected was 35, 50 and 70 MPa for units one, two and three respectively. Except where it was impractical to do so, the units are designed to comply with the New Zealand concrete design standard (NZS 3101 1995), including amendments up to February 2004.

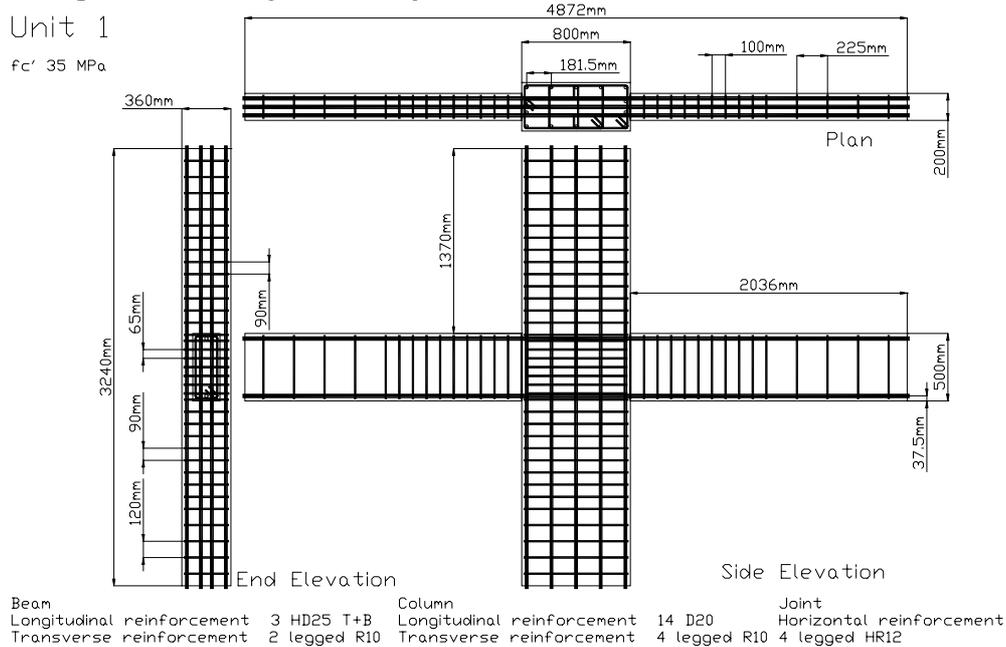

**Figure 4 Principal dimensions and reinforcement plan of unit 1B (Brooke)**

Where possible dimensions were kept the same as those used by Young (Young 1998) and Megget et al. (Megget et al. 2003). The beam dimensions were 500 mm deep and 200 mm wide. The columns were 360 mm wide, and the column depths were determined by bond strength requirements. Using 3 HD25 reinforcing bars gave a reinforcement ratio ( $A_s/bd$ ) of 1.6 %. For unit 1B this was greater than the maximum ratio of 1.5% allowed by NZS 3101:1995. For units two and three, the higher target concrete strengths allow higher reinforcement ratios (2% and 2.67% respectively). Details of unit 1B can be seen in **Figure 4**, and design details of the units tested by Young (1998) and Megget et al. (2003) are summarised in Table 2. Note that bond failure occurred in all these four units at 4.5% drift or less.

There are two equations for establishing the maximum ratio of reinforcing bar diameter to column depth in NZS 3101. The column depth required to allow the use of 25 mm reinforcing bar was

**Table 2. Bond strength details of University of Auckland tests**

Unit	Column depth	$f'_c$ actual	$f_y$ actual	$d_b$	$d_b$ allowed*	$P_w$ beam	Bond failure drift
	(mm)	(MPa)	(MPa)	(mm)	(mm)	(%)	(%)
Young	520	49.2	519	16	24.7	1.13	4.5
Megget et al. 1	520	29.3	588	16	16.8	0.64	1.7
Megget et al. 2	520	40.4	588	16	19.8	1.31	3.4
Megget et al. 3	520	40.9	588	16	19.9	0.64	2.8
Unit 1B	800	31.2	552	25	27.2	1.59	-

\* Maximum bar size allowed by NZS 3101:1995 excluding amendment 3. Maximum allowed including amendment 3 is 70% of presented value.

determined using the less conservative equation 7-14 from clause 7.5.2.5 (NZS 3101 1995),

$$\frac{d_b}{h_c} \leq 6 \left( \frac{\alpha_t \alpha_p}{\alpha_s} \right) \alpha_f \frac{\sqrt{f'_c}}{\alpha_o f_y} \quad (1)$$

In equation 7-14  $d_b$  is the bar diameter,  $h_c$  is the column depth,  $f'_c$  is concrete strength and  $f_y$  is the nominal yield stress of the reinforcement used. The  $\alpha$  factors account for whether the joint is part of a one- or two-way frame, the overstrength factor of the reinforcing steel, the depth of fresh concrete cast beneath a given bar, axial load and the ratio of the areas of top and bottom steel in the beam. Clause 7.5.2.5 is modified in amendment three to NZS 3101:1995 to allow for the more severe bond demands placed on the joint by high strength reinforcement. The amendment requires that the maximum bar diameter allowed shall be 70% of the value given by equation 7-14 (when the calculated inter-storey drifts equal the maximum drift limits in NZS4203), unless one or more of the given conditions is satisfied. These conditions are;

- Grade 300 reinforcement shall be used for longitudinal beam steel through the joint;
- Inter-storey deflections are calculated using the time history method and satisfy the limits in NZS4203 (clause 2.5.4.5);
- The storey drifts at the ultimate limit state do not exceed 1.2% when calculated using the equivalent static or modal response spectrum methods;
- The beam column joint is protected from plastic hinge formation at the faces of the column;
- The plastic hinge rotation at either face of the column does not exceed 0.006 radians.

Units 1-3 designed at the University of Auckland by Megget et al were unlikely to fulfil any of the five conditions, resulting in large column sizes being required, especially for unit 1 due to the low target concrete strength used. The design of the column depth of unit 1B is summarised in Table 3. The column depth was calculated using the target and actual material properties. When the actual yield stress was used the overstrength factor was taken as 1.15 to allow for the strain-hardening only. Note that the units were cast on their side so no allowance was required for fresh concrete depth beneath the reinforcement. For reasons of practicality the column depth of unit 1 was reduced to 800 mm. This value is close to what would have been designed without amendment three to NZS 3101:1995.

### 3.2 Loading Sequence


Unit one was tested in the University of Auckland Civil Engineering test hall, lying parallel to the floor. It was intended that an elastic load cycle to 75 % of the nominal yield strength would be

completed in both loading directions. Problems were encountered with the test setup during the first semi cycle. These caused the applied load to exceed the yield load, and a decision was made to load the unit in the other direction to a displacement equal to that reached in the first direction (see **Figure 6**). Following this “elastic” cycle, double reversing cycles to 1.5%, 2%, 3% and 4% lateral drift were applied, continuing until a significant drop in strength occurred.

**Table 3. Design of column depth for unit 1B**

$f'_c$ nominal	$f'_c$ measured	$d_b$	$f_y$ nominal	$f_y$ actual	$\alpha_o$	$\alpha_t$	$\alpha_p$	$\alpha_s$	$\alpha_f$	$h_c$ nom.	$h_c$ act.
(MPa)	(MPa)	(mm)	(MPa)	(MPa)						(mm)	(mm)
35	31.2	25	500	552.4	1.4*	1.0	1.0	1.55	1.0	955	918

\* 1.15 for  $h_c$  act. calculation.

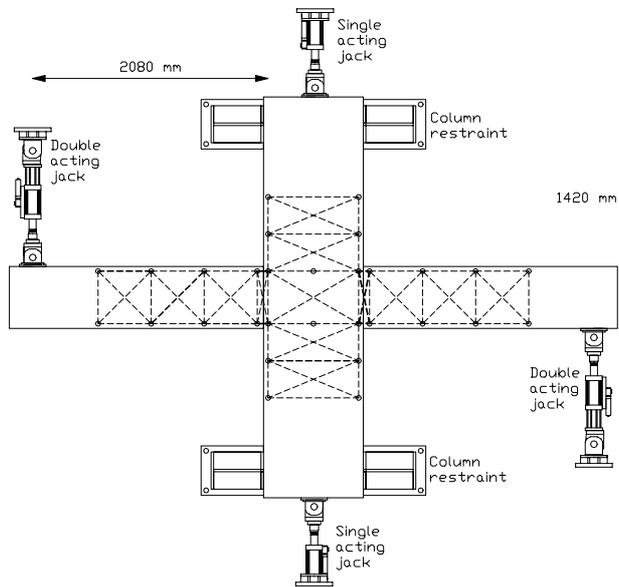

**Figure 5 Portal gauge layout and loading arrangement for unit 1B.**

The unit was instrumented extensively with portal displacement gauges as shown in **Figure 5**. Displacement at the load point was measured using turnpot gauges.

### 3.3 Test Observations and Results

From the first semi-cycles of the test it was determined that the yield lateral drift of the unit was approximately 1.27%. This value was approximately in agreement with the value of 1.35% predicted using methods presented by Priestley (Priestley 1998). Using standard moment-area theory and the deformations measured on the beam alone it is straightforward to evaluate the effective moment of inertia of the beams based on the force and displacement at yield, and assuming a linear force-displacement relationship up to first yield. The ratio of effective to gross moment of area is

$$\frac{I_e}{I_g} = \frac{FL^3}{3\delta E_c I_g} \quad (2)$$

Where  $F$  is the force,  $L$  is the length from the application point of the force to the column face,  $\delta$  is the displacement of the load point due to beam shear and flexure only,  $E_c$  is the elastic modulus of concrete as determined in NZS 3101:1995, and  $I_g$  is the gross section moment of inertia. This calculation is summarised in Table 4. The effective moment of inertia of unit 1 is notably higher than


the value of  $0.32I_g$  suggested in the amendment 3 of NZS 3101:1995. However the NZS3101 amendment effective I values are for beams with the more prototypical lower reinforcement ratios ( $\sim 0.7\%$ ) than that of unit 1B ( $p=1.6\%$ ).

When compared to the nominal column shear force, i.e. the column shear force calculated to occur when the beams develop their nominal moment capacity, the yield strength of unit 1 was reasonably close to that calculated using actual material properties (see **Figure 6**).

**Table 4 Calculation of effective moment of inertia for beams in Unit 1B**

Beam	Yield Force	Beam Length	Yield Displacement*	$f'_c$	$E_c$	$I_g$ Beam	Ratio $I_c/I_g$
	(kN)	(mm)	(mm)	(MPa)	(MPa)	(mm <sup>4</sup> )	
Left	166.9	2085.25	19.7	31.2	25445	2.083E+09	0.48
Right	165.4	2078.25	19.9	31.2	25445	2.083E+09	0.47

\*Beam shear and flexural displacement components only

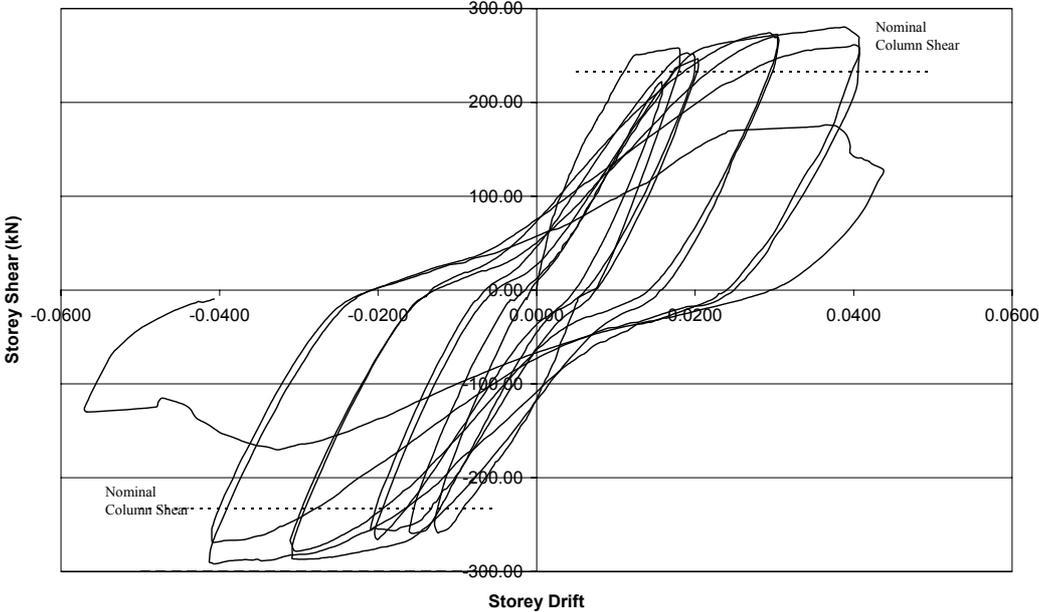

**Figure 6 Unit 1B storey column shear versus storey lateral drift.**

The damage sustained by unit 1B during testing followed expected patterns. Shear and flexural cracks formed in both beams, eventually linking across the full depth of the beams. Concurrently, fine flexural cracks developed in the column, and shear cracking occurred in the joint zone. These cracks in the column and joint did not open beyond approximately 0.5 mm, indicating that the column reinforcement remained within its elastic strain range. For the cycles to 2% drift or more, almost all damage occurred in the beam plastic hinge zones, with cracks adjacent to the column on both sides opening to approximately 7 mm when the drift was 3%.

In contrast to the earlier tests at the University of Auckland unit 1B did not experience bond failure, despite not conforming with the most recent amendment to NZS 3101:1995. The beam reinforcement slipped no more than 2.2 mm through the joint zone at a lateral drift of 5%. Moreover the stiffness of the unit at low load levels remained similar through out the test (see **Figure 6**). It is possible the improved response is related to the large quantity of vertical reinforcement in the column region, which is thought to improve bond performance. Equation 11-7 of NZS 3101:1995 required vertical joint shear strength of 516 kN, while the six column interior HD20 reinforcing bars provided a total nominal strength of 942 kN.

Testing was halted when the primary longitudinal reinforcement of both beams buckled during the first complete cycle to 5% lateral drift. Therefore, the maximum drift achieved before strength dropped below 80% of the previous maximum was 4%, and the ductility achieved was  $\mu = 3.14$  based on a yield drift of 1.27%. It is noted that the final drift level considerably exceeds the maximum allowable drift in NZS 4203 (NZS 4203 1992), AS/NZS 1170 (AS/NZS 1170.4 2003) and over-seas codes of practice (Fenwick et al. 2002).

#### 4 CONCLUSIONS

- Based on the analysis of a database of previous test results design drift limits for reinforced concrete frames should be between 1.20% and 2.24 % depending on building height and reinforcement grade used.
- In previous beam-column joint tests with Grade 500 beam reinforcement, bond failure occurred between storey drifts of 1.7 and 4.5%. The first unit with D25H bars did not slip substantially before buckling of the plastic hinge zones prevented further testing although just complying with the current Standard.
- The unexpectedly good bond performance of the test unit may have occurred because of the large quantity of vertical reinforcement in the joint region. Further tests are to be conducted to investigate this possibility.

#### REFERENCES

- AS/NZS 1170.4. (2003). "Draft Australia/New Zealand Standard Calibration Test Version Earthquake Loading." Post Public Comment Draft 8, Standards New Zealand, Wellington, 66.
- Blakeley, R. W. G., Edmonds, F. D., Megget, L. M., and Wood, J. H. "Cyclic load testing of two refined concrete beam-column joints." South Pacific Regional Conference on Earthquake Engineering, 459-492.
- Blakeley, R. W. G., Megget, L. M., and Priestley, M. J. N. (1975). "Seismic Performance of two full sized reinforced concrete beam-column joint units." Bulletin of the New Zealand National Society for Earthquake Engineering, 8(1), 38-69.
- Fenwick, R. C., Lau, D., and Davidson, B. (2002). "A Comparison of the Seismic Design Requirements in the New Zealand Loadings Standard with other Major Design Codes." Bulletin of the New Zealand National Society for Earthquake Engineering, 35(3), 190-203.
- Fenwick, R. C., and Megget, L. M. (2003). "The Influence of Using Grade 500 Reinforcement in Beam Column Joint Zones and on the Stiffness of Reinforced Concrete Structures." 9089, Auckland UniServices Limited, Auckland.
- Hakuto, S., Park, R., and Tanaka, H. (1999). "Effect of Deterioration of Bond of Beam Bars Passing through Interior Beam-Column Joints on Flexural Strength and Ductility." ACI Structural Journal, 96(5), 858-864.
- Lin, C. (1999). "Seismic Behaviour and Design of Reinforced Concrete Interior Beam Column Joints," PhD Thesis, University of Canterbury, Christchurch.
- Megget, L. M., Fenwick, R. C., and Amso, N. "Seismic Performance of Internal Beam-Column Joints with 500 Grade Reinforcement." Pacific Conference on Earthquake Engineering, Christchurch, 1-10.
- NZS 3101. (1995). "The Design of Concrete Structures." Standards New Zealand, Wellington, 256.
- NZS 4203. (1992). "Code of practice for general structural design and design loadings for buildings." Standards New Zealand, Wellington.
- Paulay, T. (1978). "A consideration of P-Delta effects in ductile reinforced concrete frames." Bulletin of the New Zealand National Society for Earthquake Engineering, 11(3), 151-160.
- Priestley, M. J. N. (1998). "Brief Comments on Elastic Flexibility of Reinforced Concrete Frames and Significance to Seismic Design." Bulletin of the New Zealand National Society for Earthquake Engineering, 31(4), 246-259.
- Young, K. L. (1998). "Anchorage Plates and Mechanical Couplers in Seismic Resistant Concrete Frames Reinforced with Threaded Bar," Masters, University of Auckland, Auckland.